



- NOTES:
- CATCH BASIN INLET TO BE CONSTRUCTED IN ACCORDANCE WITH ASTM C478 (ASHROT) W 199) & C890 UNLESS SHOWN ON PLANS OR NOTED IN STANDARD SPECIFICATIONS.
  - REINFORCING FOR INLET UNIT, 3 EA. #4 HORIZONTAL BARS.
  - REINFORCING FOR TOP UNIT, 2 EA. #3 HORIZONTAL BARS.
  - ALL REBAR TO MEET ASTM A615 GRADE 60. CATCH BASINS PER STANDARD PLAN B-1. ALL PIPE SHALL BE INSTALLED IN ACCORDANCE WITH STANDARD SPECIFICATIONS UNLESS APPROVED OTHERWISE.
  - FACTORY PROVIDED KNOCKOUTS UNLESS KNOCKOUTS NEED NOT BE GROUDED IF WALL IS LEFT IN PLACE.
  - ALL REINFORCED CAST-IN-PLACE CONCRETE SHALL BE CLASS 4000.
  - THE MAX. DEPTH FROM THE FINISHED GRADE TO THE PIPE INVERT IS 5'-0".
  - ANY PROTRUDING ENDS OF PIPES SHALL BE TRIMMED FLUSH WITH THE INSIDE WALLS AND GROUDED TO THE SATISFACTION OF THE CITY.
  - CATCH BASIN FRAME AND GRATE SHALL BE CAST INTO 6" CONCRETE SLAB AND BE ACCORDANCE WITH WSOT STANDARD SPECIFICATIONS UNLESS APPROVED OTHERWISE.
  - CONTRACTOR SHALL USE PRECAST INLET STRUCTURES UNLESS APPROVED OTHERWISE.
  - INSTALL REMOVABLE TRAP IN ACCORDANCE WITH THE STANDARD CATCH BASIN TRAP DETAIL.


STANDARD TYPE 1 CATCH BASIN  
N/S

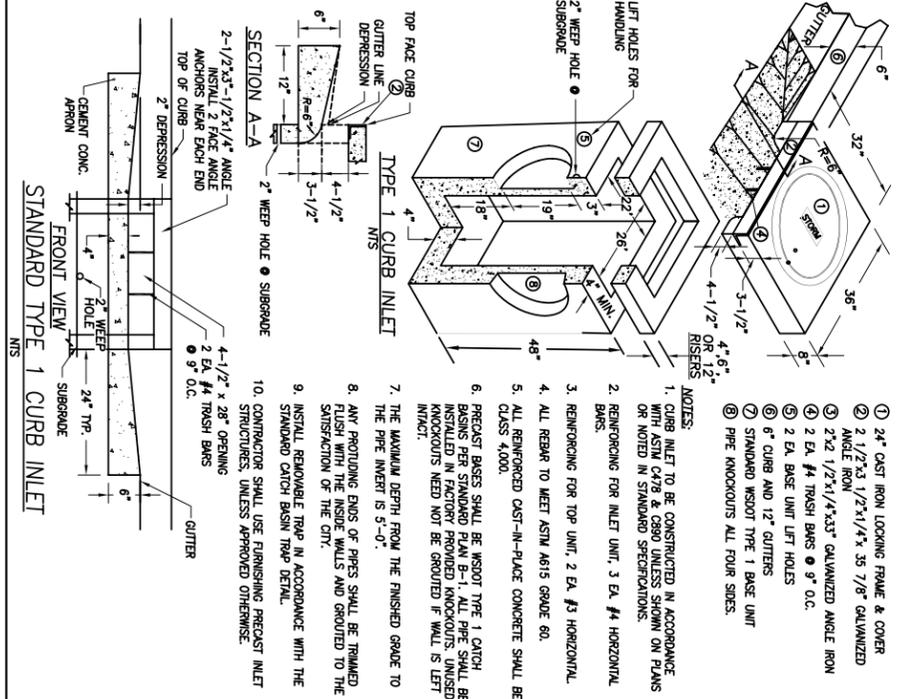


STANDARD TYPE 1 CURB INLET  
N/S

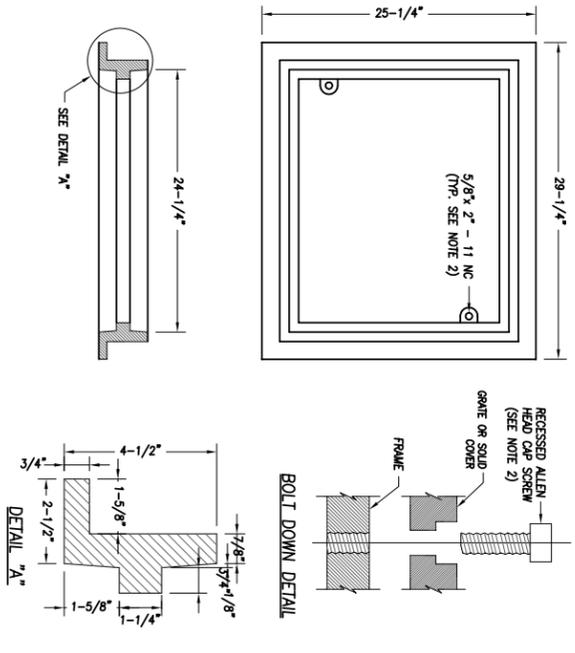


STANDARD CATCH BASIN FRAME  
N/S

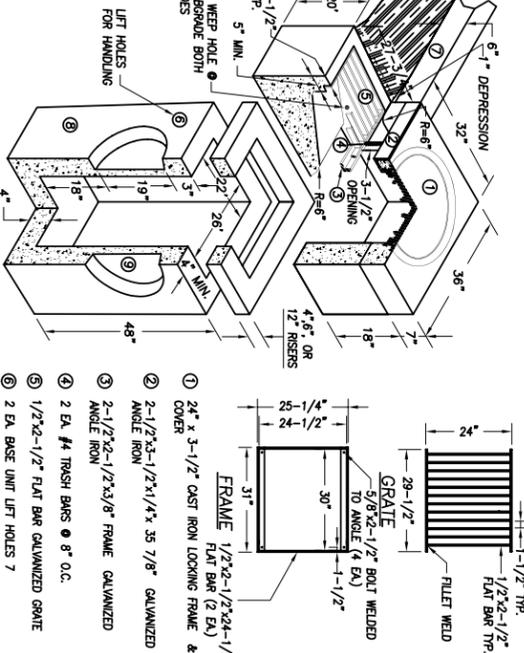


STANDARD TYPE 1 COMBINATION CURB INLET  
N/S

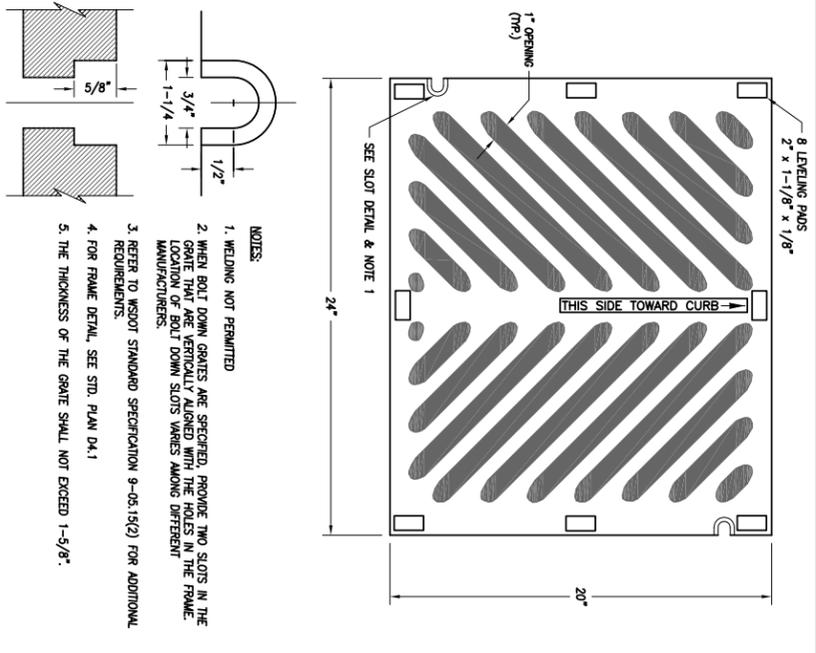


STANDARD HERRINGBONE CATCH BASIN GRATE  
N/S

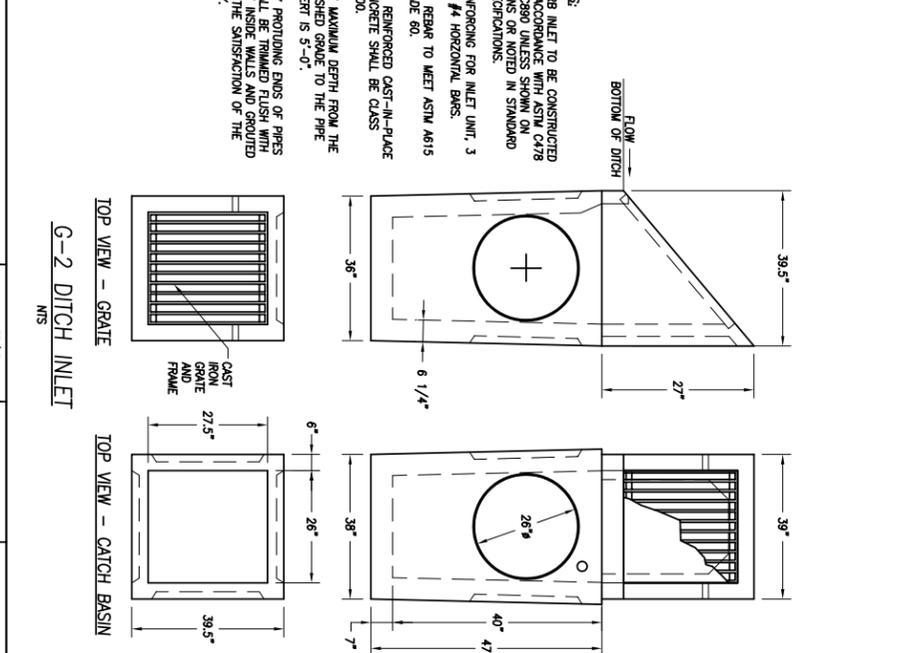

G-2 DITCH INLET  
N/S

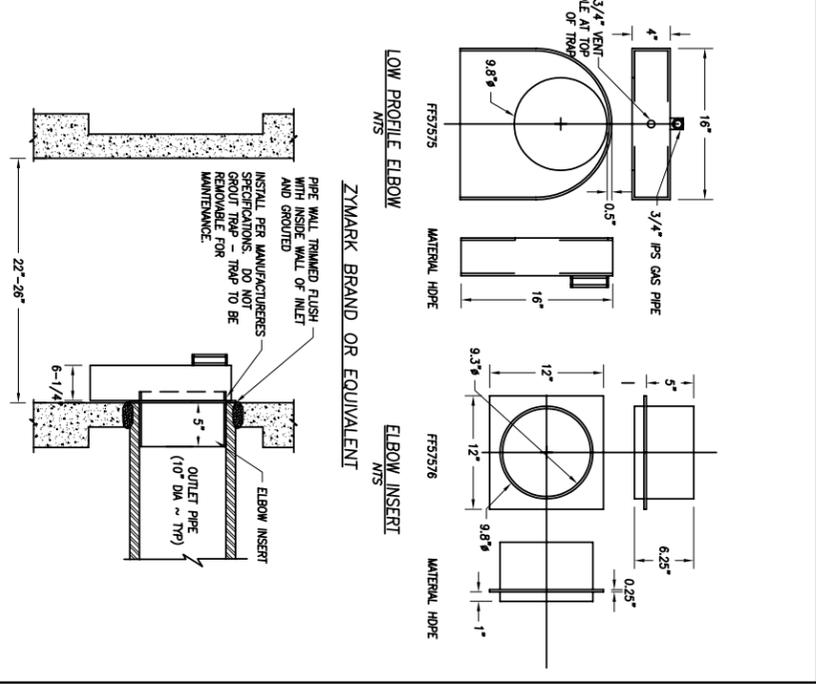

STANDARD CATCH BASIN TRAP  
N/S

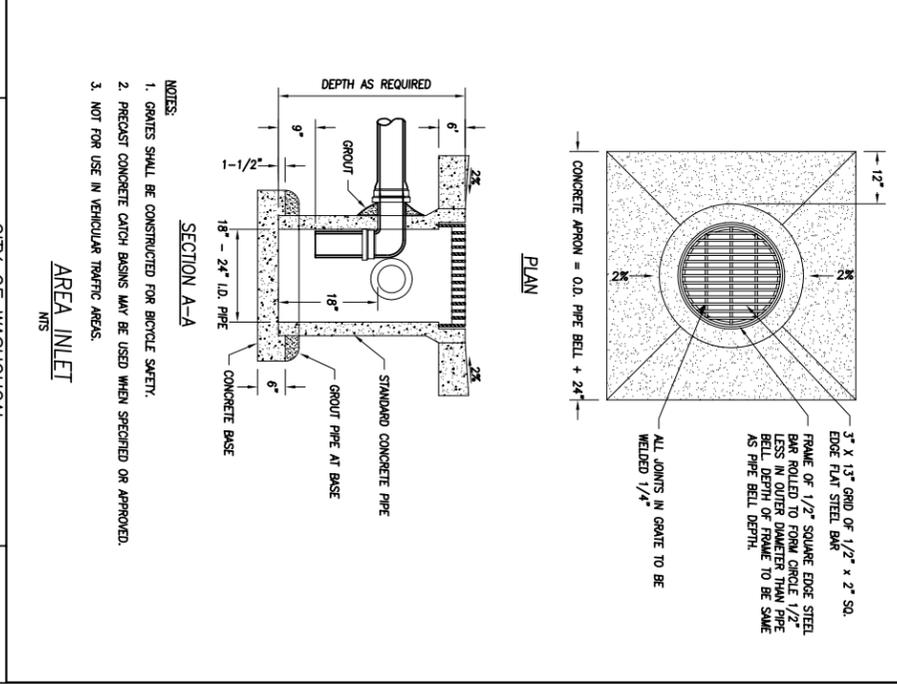

AREA INLET  
N/S

BY	DATE	NO.	REVISIONS	DESIGNED	EA/UF	SCALE	JOB NUMBER	CITY OF WASHOUGAL	DRAWING NUMBER
ABC	9/03		APPROVED (CD) VERSION 1.1	DRN	BS			STANDARD STORM DRAINAGE	
ABC	10/03		APPROVED (CD) VERSION 1.2	DRN	BS			DETAILS - SHEET 2	
				DRN	BS				
				DRN	BS				
				DRN	BS				