


RISER
TO BE USED IN SEWER
CONSTRUCTION OVER 14' IN DEPTH

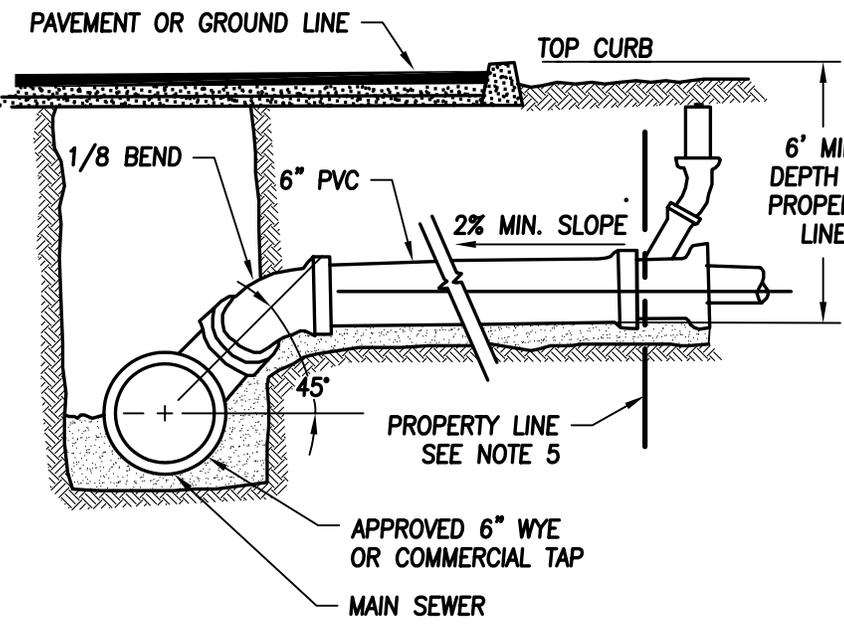

TYPICAL HOUSE BRANCH

SERVICE LATERAL CONNECTIONS

NTS

NOTES:

1. ALL SERVICE LATERALS SHALL BE 6" MIN.
2. SERVICE LATERALS SHALL BE PLUGGED AS PROVIDED BY SECTION 7-17.3(2)A OF THE STANDARD SPECIFICATIONS. SERVICE LATERALS SHALL BE CLEARLY MARKED AS PROVIDED IN SECTION 7-18.3(5) OF THE STANDARD SPECIFICATIONS.
3. APPROVED COMMERCIAL TAPS:
 - ~ SEALTIGHT® TYPE "C" OR "D" SEWER SADDLE.
 - ~ FOWLER QUIK-WAY® SEWER TAP
 - ~ FOWLER "T & L"® SEWER TEE
 - ~ FOWLER "INSERTA TEE"®
 - ~ "TAP-TITE"® SEWER TEE
4. TRANSITIONS BETWEEN DISSIMILAR PIPE MATERIALS OR SIZES SHALL BE MADE WITH APPROVED ADAPTERS (FERNCO, CAULDER, OR EQUAL).
5. IN NEW SUBDIVISIONS AND OTHER CONSTRUCTION INVOLVING NEW ROADS, INSTALL LATERALS TO 6 FEET BEHIND PROPERTY LINE FOR SEWERS IN STREET RIGHT-OF-WAY.