




CEMENT CONCRETE
BARRIER CURB

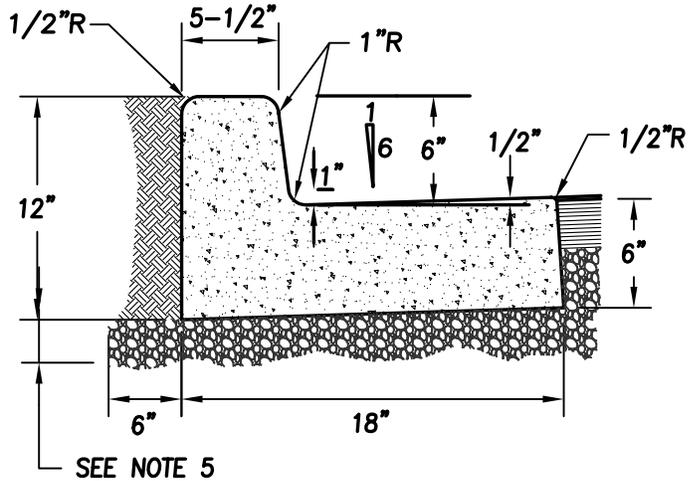

CEMENT CONCRETE BARRIER
CURB AND GUTTER

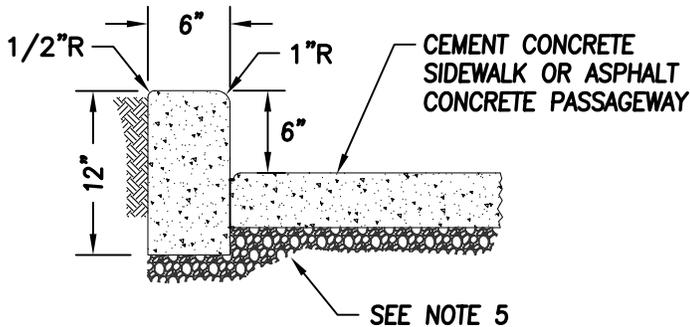

CEMENT CONCRETE
PEDESTRIAN CURB

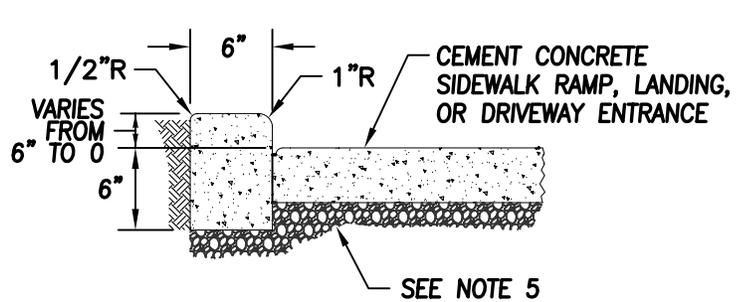

CEMENT CONCRETE
PEDESTRIAN CURB
AT SIDEWALK RAMPS & LANDINGS,
AND DRIVEWAY ENTRANCES

NOTES:

1. CONCRETE SHALL BE 3000 PSI MIN COMMERCIAL CONCRETE.
2. CONTROL JOINT SPACING NOT TO EXCEED 15 FEET. THE DEPTH OF THE JOINT SHALL BE AT LEAST 1-1/2 INCHES. CONTROL JOINTS IN CURB SHALL MATCH PATTERNS IN ADJACENT SIDEWALK.
3. CRUSHED SURFACING SHALL BE TO SUBGRADE OF STREET SECTION OR 3 INCHES, WHICHEVER IS GREATER, AND SHALL EXTEND 6" BEHIND THE CURB.
4. CURB TO BE BRUSH FINISHED. ALL EXISTING EDGES SHALL BE SAWCUT.
5. 3" DEPTH CRUSHED SURFACING TOP COURSE COMPACTED TO 95% OF MAX DRY DENSITY.

CONCRETE CURBS
NTS