


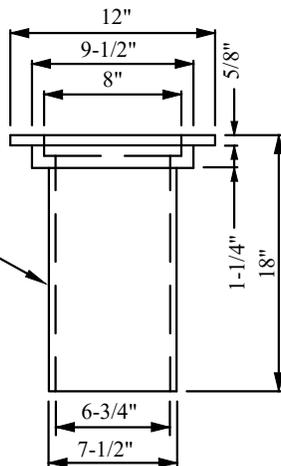


LID AND 1/4" X 4" ROD STOCK TO BE CAST INTEGRALLY (NOT WELDED)

RAISED LETTER




CHANNEL DEPTH 3/4" TO 1" DEEP



SEE NOTE #2

CONCRETE PAD FOR VALVE BOXES NOT SET IN PAVED AREAS. (24" SQUARE, 4" THICK)

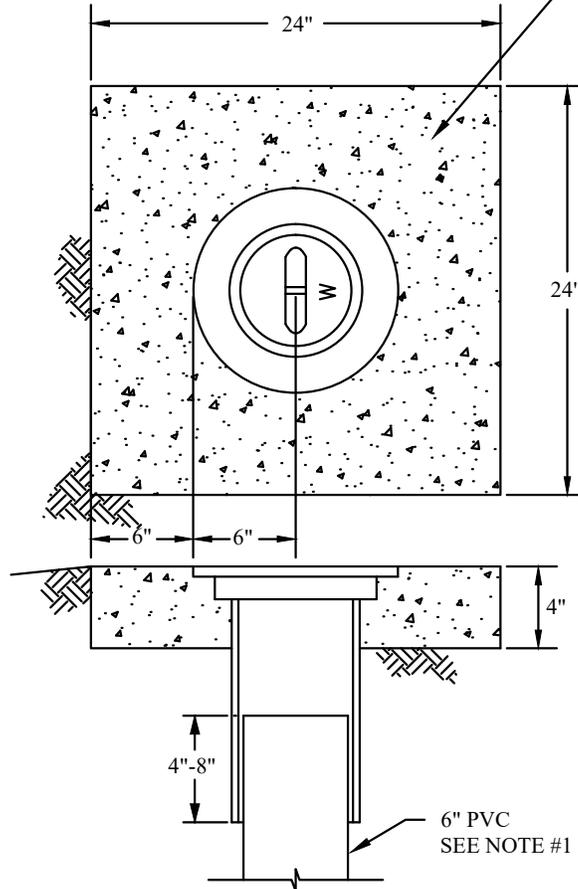

6" PVC SEE NOTE #1

NOTES:

1. EXTENSIONS SHALL BE 6" ASTM D 3034 SDR 35 PVC PIPE (ONE PIECE)
2. VALVE BOX SHALL BE U.S. FILTER/PACIFIC WATER WORKS NO. 910 OR EQUAL.
3. THE LID SHALL INCLUDE THE FORT VANCOUVER LOGO AND "W" IN THE DESIGN.
4. IF THE ORIGIN IS OTHER THAN USA, THE COUNTRY OF ORIGIN SHALL BE CAST ON THE UNDERSIDE OF THE LID
5. THERE SHALL BE 1/2" CLEARANCE UNDER THE PIN CAST INTO THE LID.
6. THE OPERATOR NUT SHALL HAVE A DEPTH FROM 18"-36" FROM FINISH GRADE TO THE OPERATOR NUT.



STANDARD VALVE BOX & COVER

DATE: December 2016

DETAIL NO.

W30