NOTES:

1. TAPPING SLEEVE SHALL BE 304 STAINLESS STEEL W/ STAINLESS STEEL FLANGE. JCM OR EQUIVALENT.
2. ALL BOLTS SHALL BE 304 STAINLESS STEEL OR APPROVED EQUAL.
3. TAPPING SLEEVE AND VALVE SHALL BE SUPPORTED BY 6" MIN. CTSC OR AS DETERMINED BY THE INSPECTOR & COMPACTED TO 95%.
4. CITY MUST WITNESS AIR TEST AND BE PROVIDED W/ WITH TAPPING COUPON.
5. TAPPING SLEEVE EDGE SHALL BE A MIN. OF 18" FROM BELL OR SPIGOT END OF EXISTING PIPE, AND A MIN. OF 18" FROM ANY OTHER TAP OR FITTING.
6. CONTRACTOR SHALL SCHEDULE THE HOT TAP WITH THE CITY 48 HOURS (2 WORKING DAYS) IN ADVANCE.
7. SIZE ON SIZE TAPS ARE NOT PERMITTED.
8. ALL THRUST BLOCKS TO BE CLASS 4000.

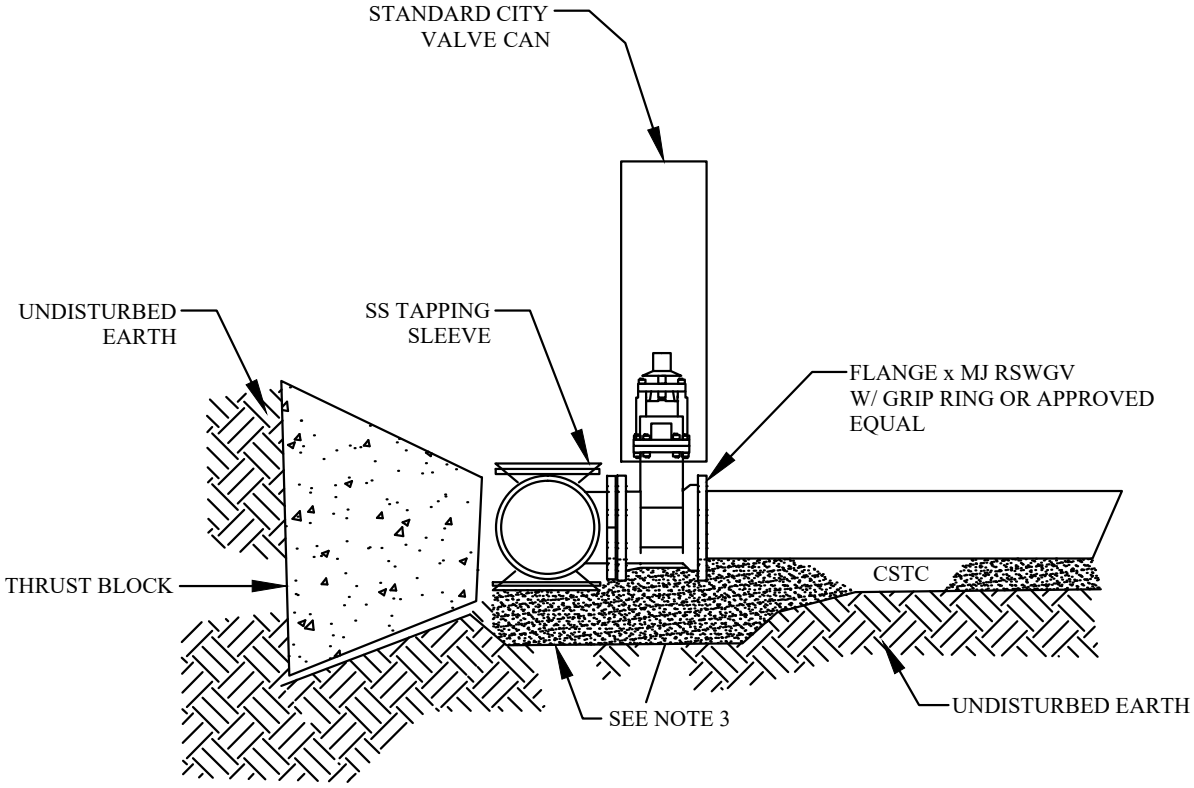

HOT TAP OF EXISTING WATER MAIN

DETAIL NO.

W60

DATE: December 2016